



CENTER FOR TESTING AND EUROPEAN CERTIFICATION LTD

,23 Sv. Patriarh Evtimij Blvd., Stara Zagora Bulgaria, tel. 00 35942/620 368; fax:00359 42/602 377

E-mail: [ctec@ctec-sz.com](mailto:ctec@ctec-sz.com), [www.ctec-sz.com](http://www.ctec-sz.com)

Център за Изпитване и  
Европейска Сертификация

### CONSTRUCTION PRODUCTS TESTING LABORATORY

Сертификат за акредитация, рег. No 252 ЛИ /07.02.2014, валиден до 07.02.2018г.,  
издаден от ИА БСА, съгласно изискванията на стандарт БДС EN ISO/IEC 17025:2006



FQ 5.10.1\_1  
Version 6  
page 1 total pages 2

## REPORT

### FROM TESTING

№ 1 11 1712 / 02.07.2015

#### 1. Screeds and mortars and floor screeds:

Cement screed "Siltek F 22" produced from Private Joint Stock Company "Terminal-M"

#### 2. Test requested by:

Private Joint Stock Company "Terminal-M", Kiev, Ukraine, application № 2-0374/29.05.2015

#### 3. Test methods:

BDS EN 13892-2:2003 Methods of test for screed materials - Part 2: Determination of flexural and compressive strength

BDS EN 13892-8:2002 Methods of test for screed materials - Part 8: Determination of bond strength

#### 4. Date of delivery of samples to the laboratory:

29.05.2015

#### 5. Quatity of test samples:

15 kg sample, supplied by the applicant.

#### 6. Date of test:

01.06.2015 ÷ 02.07.2015

Laboratory manager: .....  
( eng. H. Angelova )



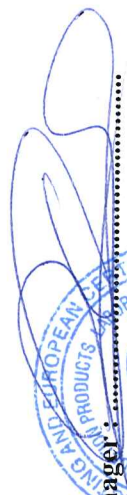
**7. Test results:**

№	Name of testing/ characteristic	Unit of measure	Standardized methods	Diary sample №	Test results (uncertainty)	Environmental conditions	Deviations, additions or exclusions from the test methods
1		3	4	5	6	7	8
1.	<b>Flexural strength</b>	N/mm <sup>2</sup>	BDS EN 13892-2:2003 p.6.1		5.53 5.09 5.95	t = 21°C RH = 56%	no
2.	<b>Compressive strength</b>	N/mm <sup>2</sup>	BDS EN 13892-2:2003 p.6.2	1664-0	21.77 23.89 24.47 21.37 25.04 25.08	t = 21°C RH = 56%	no
3.	<b>Bond strength</b>	N/mm <sup>2</sup>	BDS EN 13892-8:2002		1.20 (cohesive fracture) 1.48 (cohesive fracture) 1.20 (cohesive fracture) 1.09 (cohesive fracture) 1.28 (cohesive fracture)	t = 21°C RH = 56%	no

**Note I:** The test results apply to the samples only.

**Note II:** The test certificate shut be entirely copied only and with agreement by the test laboratory.

Tested by:   
( T. Laskova )

Laboratory manager:   
( eng. H. Angelova )

